





U42

ANTENNA STATUS
RED CROSSING
ON/THRESHOLD EXCEEDED

POWER

BATTERY
DISCONNECT

VOLT AMP

DuraComm®


DuraComm®





NOTE: 2" Conduit must use large swept bends (to allow for ant coax)

Concrete Pad
Minimum 4" thick
Size
Minimum 29" wide x 38"

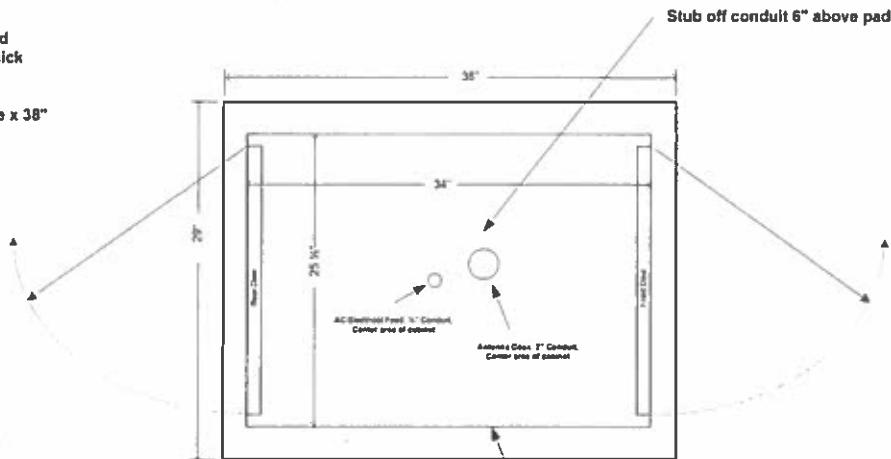

Cabinet is installed on a 24" high pedestal

NOTE: Pad may be constructed larger than minimum size (38x29) 96" x 48"

Sierra Electronics		Sheet No	1-1
Date	10/16/2018	Customer	White Pine County
Project			
Ely Water Tank Repaeter			
Drawing			
Outdoor Cabinet - Concrete Pad			
Rev No	1.0	Part	1 - Cab Pad
		Doc	MC/456